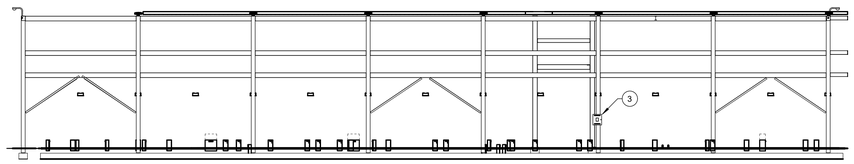

2 TE-104

TRESTLE ELEVATION FOR SECURITY CAMERA ENCLOSURE

SCALE: NOT TO SCALE

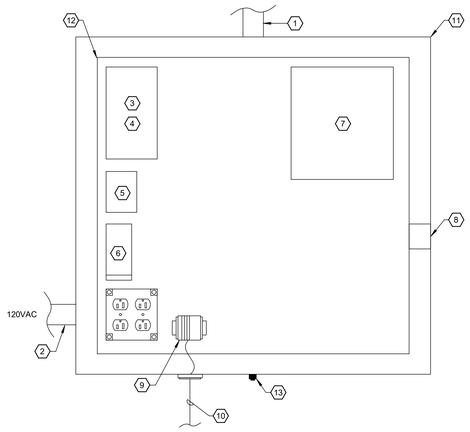

BILL OF MATERIALS	
#	DESCRIPTION
1	INCOMING LV/FIBER CONDUIT
2	ENCLOSURE POWER - COORDINATE WITH ELECTRICAL
3	4-PORT MANAGED ETHERNET POE SWITCH
4	SINGLE ETHERNET PORT SURGE PROTECTOR
5	ELECTRONIC HEATER CONTROLLER
6	ENCLOSURE HEATER
7	FIBER TERMINATION HOUSING
8	DOOR POSITION SWITCH
9	GROUNDING TERMINAL STRIP
10	6 AWG GROUND IN CONDUIT TO NEW 3/4" X 10'-0" ROD
11	24"x24"x12" NEMA 4X ENCLOSURE
12	ENCLOSURE BACK PLATE
13	ENCLOSURE DRAIN PLUG

SECURITY CAMERA ENCLOSURE

SCALE: NOT TO SCALE

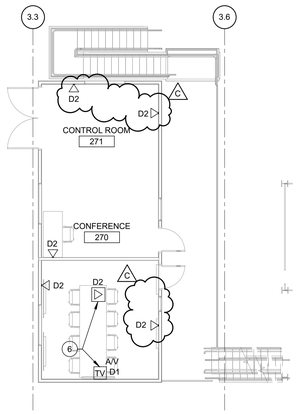

3 TE-104

DATA & SECURITY WET PROCESS OFFICE

SCALE: 1/8" = 1'-0"

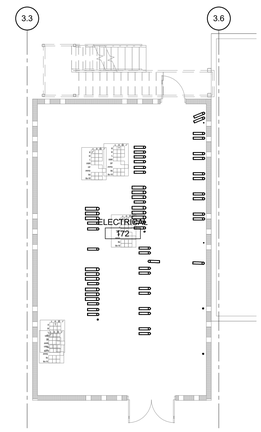

4 TE-104

DATA & SECURITY WET PROCESS GROUND FLOOR PLAN

SCALE: 1/8" = 1'-0"

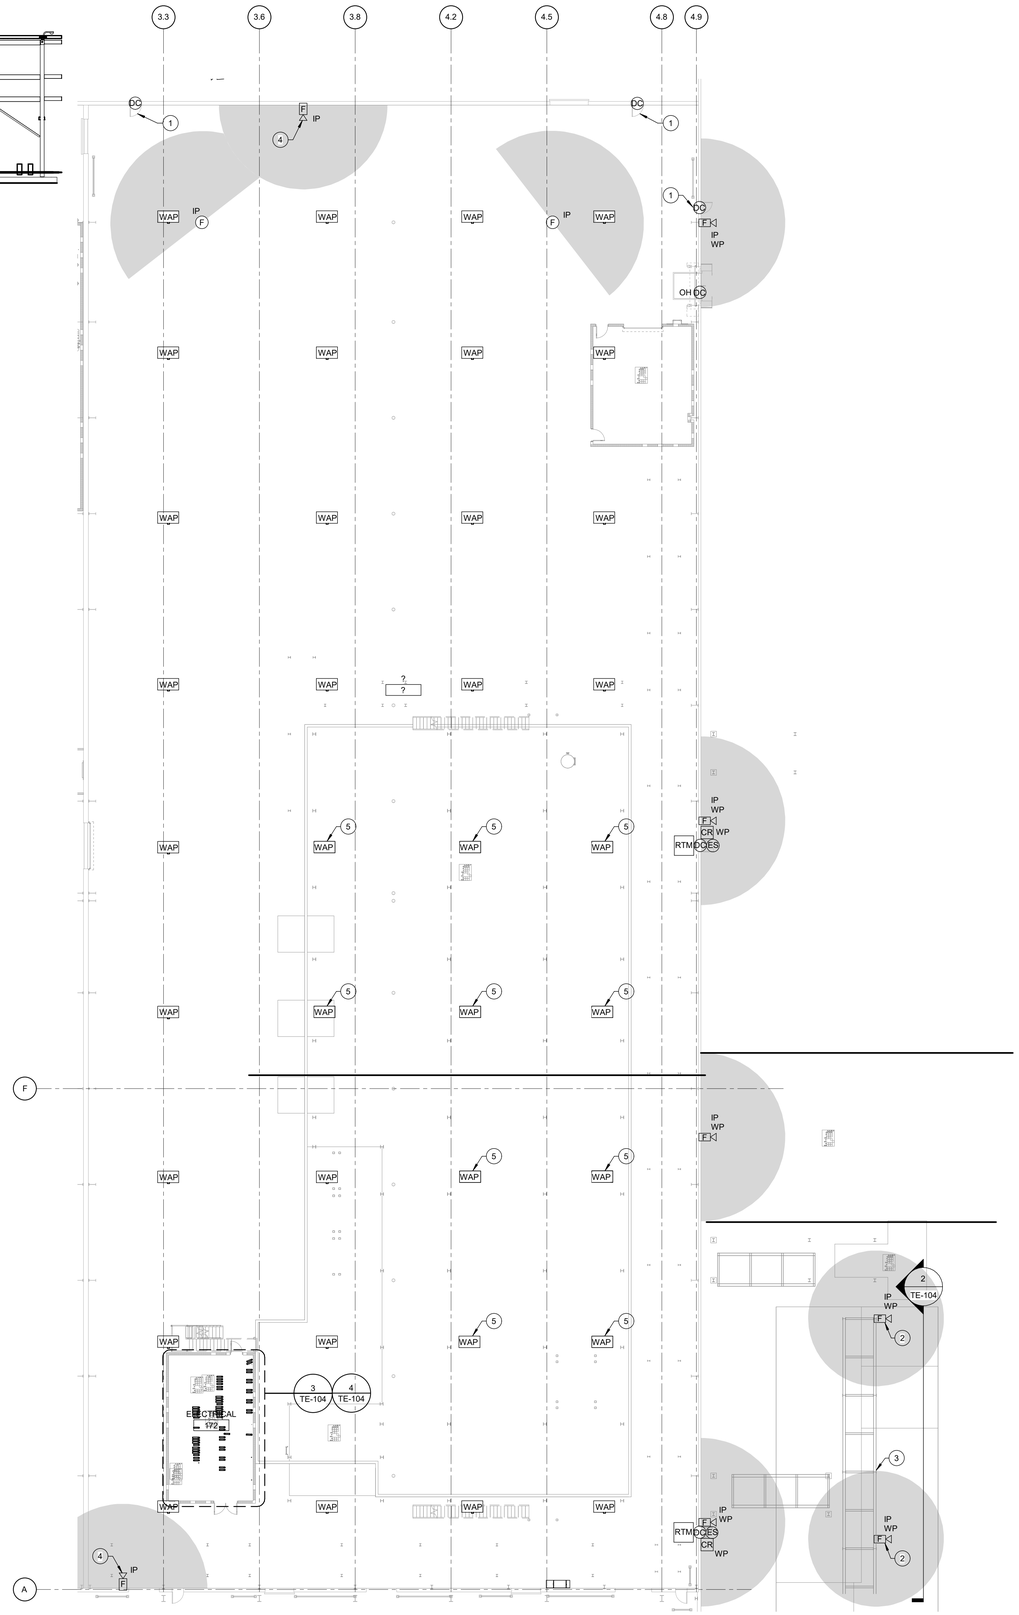

1 TE-104

DATA & SECURITY WET PROCESS GROUND FLOOR PLAN

SCALE: 1/16" = 1'-0"

GENERAL NOTES

A. SEE SHEET TA-001 FOR SYMBOL SCHEDULE AND GENERAL NOTES.

B. PROVIDE FULL WIRELESS COVERAGE. CURRENT SPACING IS BASED ON 2,000 SQUARE FEET PER DEVICE.

PLAN NOTES (#)

1. EMERGENCY EXIT DOOR. PROGRAM ACCESS CONTROL SYSTEM TO GENERATE ALARM AT THE HEADEND WHEN THE DOOR IS OPEN.
2. CAMERA TO BE MOUNTED ON THE TRESTLE WITH A PARAPET CAMERA MOUNT TO ENABLE A 360° FIELD OF VIEW OF THE TANK FARM. CAMERA CIRCUIT TO TERMINATE IN THE SECURITY CAMERA ENCLOSURE. SEE DETAILS ON THIS SHEET.
3. LOCATION OF THE SECURITY CAMERA ENCLOSURE. MOUNTING HEIGHT = 6'-0" TO THE TOP OF ENCLOSURE.
4. CAMERA INTENT IS TO VIEW FORKTRUCK AND PEDESTRIAN TRAFFIC MOVING BETWEEN THE NORTH AND SOUTH ENDS OF THE BUILDING. COORDINATE EXACT LOCATION OF THE CAMERA WITH THE OWNER.
5. INSTALL DATA CIRCUIT, JACKS, AND WIRELESS ACCESS POINT UNDER THE MEZZANINE.
6. CONTRACTOR TO PROVIDE AN HDMI CABLE BETWEEN THE WALL BOX AND THE BOX BEHIND THE TV. BOTH WALL BOXES TO INCLUDE HDMI JACKS. COORDINATE WITH ELECTRICAL CONTRACTOR FOR HEIGHT OF WALL PLATES.

SSOE®

CONSULTANTS:

Issued For BULLETIN
10/11/2022
www.ssoe.com

SEAL ON THIS DOCUMENT AUTHORIZED BY:

APPLY STAMP IN BLUEBEAM

PROJECT INFORMATION:

BROWNFIELD MODIFICATIONS

CLIENT INFORMATION:

ASCEND ELEMENTS

ASCEND ELEMENTS
9172 INDUSTRIAL DR NE
COVINGTON, GA
30014

CLIENT PROJECT NO: XXX-XXXXX-XX

NO.	DATE	SUBJECT
C	10/11/22	ISSUED FOR BULLETIN 2
B	07/22/22	ISSUED FOR BULLETIN 1
A	06/06/22	ISSUED FOR IFC

REVISION OR ISSUE

SSOE, Inc.
1001 Madison Avenue
Toledo, OH 43604
T. (419) 255-3830

PROJECT NO: 021-01975-00
PROJECT MANAGER: R. FOX
DESIGNED: J. DELANEY
CHECKED: M. SMITH

DRAWING TITLE:
DATA & SECURITY WET PROCESS GROUND FLOOR PLAN

DRAWING NO:
TE-104

TB_REV 1.0

BIM 360://Battery Resources Brownfield Modifications/021019750O_T20_SSOE.rvt
DATE: 10/10/2022 3:13:03 PM