GENERAL NOTES

A. SEE SHEET TA-001 FOR SYMBOL SCHEDULE AND GENERAL NOTES.

B. UNLESS OTHERWISE NOTED, NOTIFICATION DEVICES IN THE OFFICE ARE TO ONLY ACTIVATE UPON AN ALARM IN THE OFFICE OR STORAGE AREAS.

PLAN NOTES

1. CONNECT SMOKE DETECTOR TO THE CLEAN AGENT SYSTEM AND PROGRAM TO ACTIVATE THE RELEASE UPON CROSS ZONING BOTH DETECTORS. COORDINATE WITH THE SPRINKLER CONTRACTOR ON EQUIPMENT MANUFACTURER AND TERMINATION OF THE DETECTORS.
2. ACTIVATE STROBE WHEN THERE IS AN ALARM IN THE DRY PROCESS AREA.
3. MONITOR FIRE SUPPRESSION CONTROL PANEL FOR ALARM, TROUBLE, AND SUPERVISORY SIGNALS.
4. ACTIVATE SPEAKER STROBE ON A GENERAL FIRE ALARM.
5. ACTIVATE SPEAKER STROBE ON A WATERFLOW ALARM FROM ADJACENT SPRINKLER RISER.
6. CONTRACTOR TO PROVIDE ONE ADDRESSABLE MONITOR MODULE AND ONE ADDRESSABLE RELAY THAT WILL BE USED TO MONITOR THE FIRE ALARM CONTROL PANEL IN THE ADJACENT TENANT SPACE. PROGRAM THE MONITOR MODULE TO ACTIVATE ON A GENERAL ALARM AND PROGRAM THE RELAY TO ACTIVATE A SUPERVISORY ALARM. COORDINATE DEVICE LOCATIONS WITH TENANTS FIRE ALARM COMPANY.

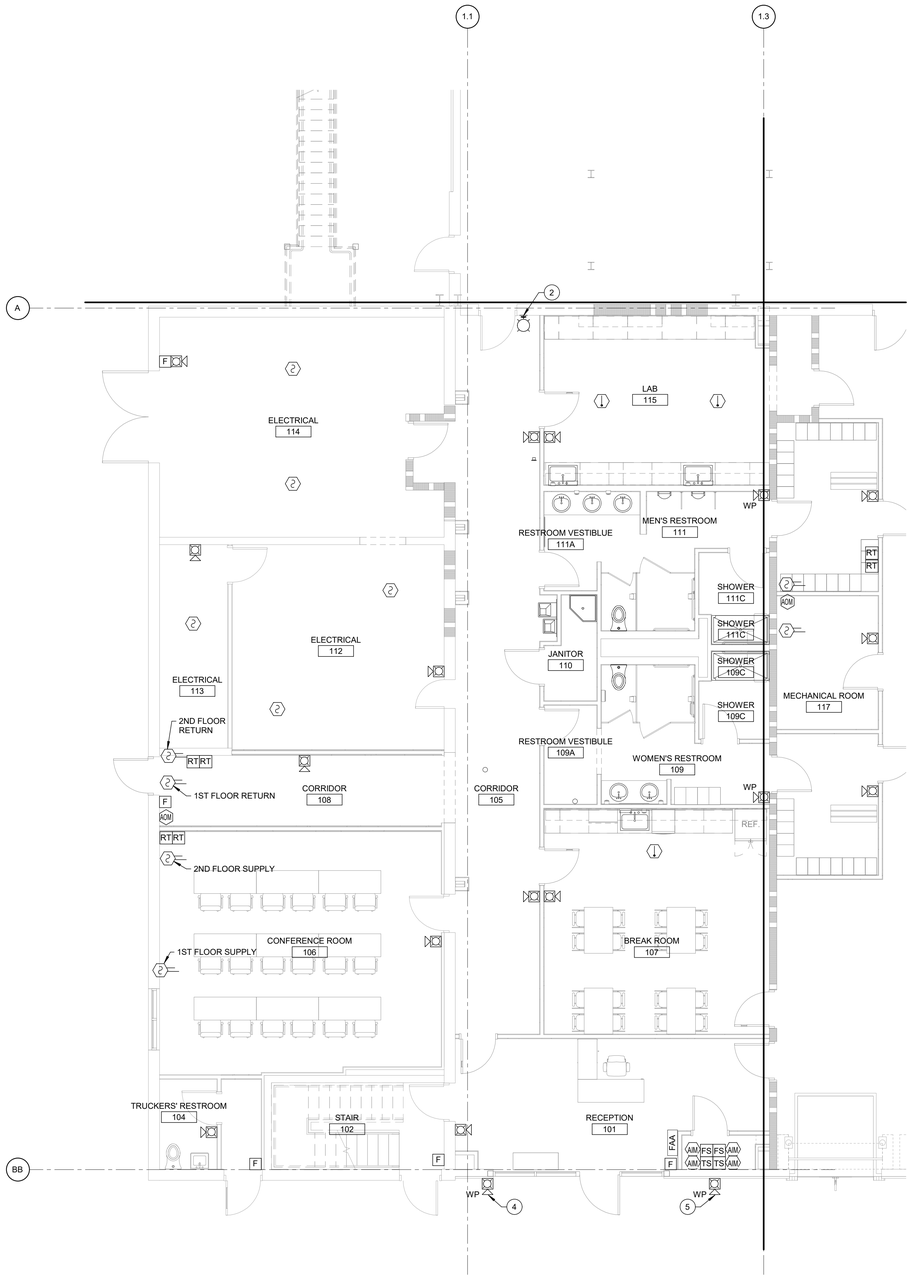

1 TF-102 FIRE ALARM FIRST FLOOR OFFICE PLAN

SCALE: 3/16" = 1'-0"

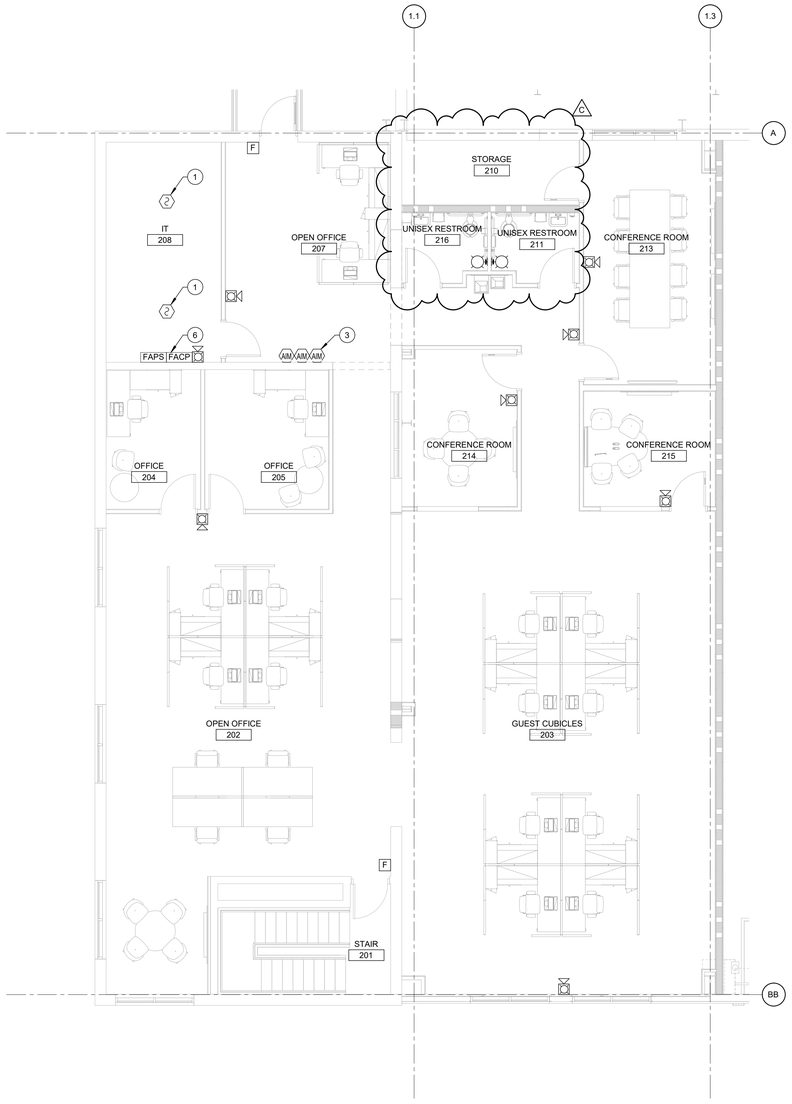

2 TF-102 FIRE ALARM SECOND FLOOR OFFICE PLAN

SCALE: 3/16" = 1'-0"

TB_REV 1.0

SSOE®

CONSULTANTS:

Issued For BULLETIN
10/14/2022
www.ssoe.com

SEAL ON THIS DOCUMENT AUTHORIZED BY:

APPLY STAMP IN BLUEBEAM

PROJECT INFORMATION:

BROWNFIELD MODIFICATIONS

CLIENT INFORMATION:

ASCEND ELEMENTS

ASCEND ELEMENTS
9172 INDUSTRIAL DR NE
COVINGTON, GA
30014

CLIENT PROJECT NO: XXX-XXXXX-XX

NO.	DATE	SUBJECT
C	10/14/22	ISSUED FOR BULLETIN 3
B	07/22/22	ISSUED FOR BULLETIN 1
A	06/06/22	ISSUED FOR IFC

REVISION OR ISSUE

SSOE, Inc.
1001 Madison Avenue
Toledo, OH 43604
T. (419) 255-3830

PROJECT NO:	021-01975-00
PROJECT MANAGER:	R. FOX
DESIGNED:	J. DELANEY
CHECKED:	M. SMITH

DRAWING TITLE:
FIRE ALARM OFFICE FLOOR PLANS

DRAWING NO:
TF-102

BIM 360://Battery Resources Brownfield Modifications/021019750O_T20_SSOE.rvt
DATE: 10/13/2022 1:54:31 PM