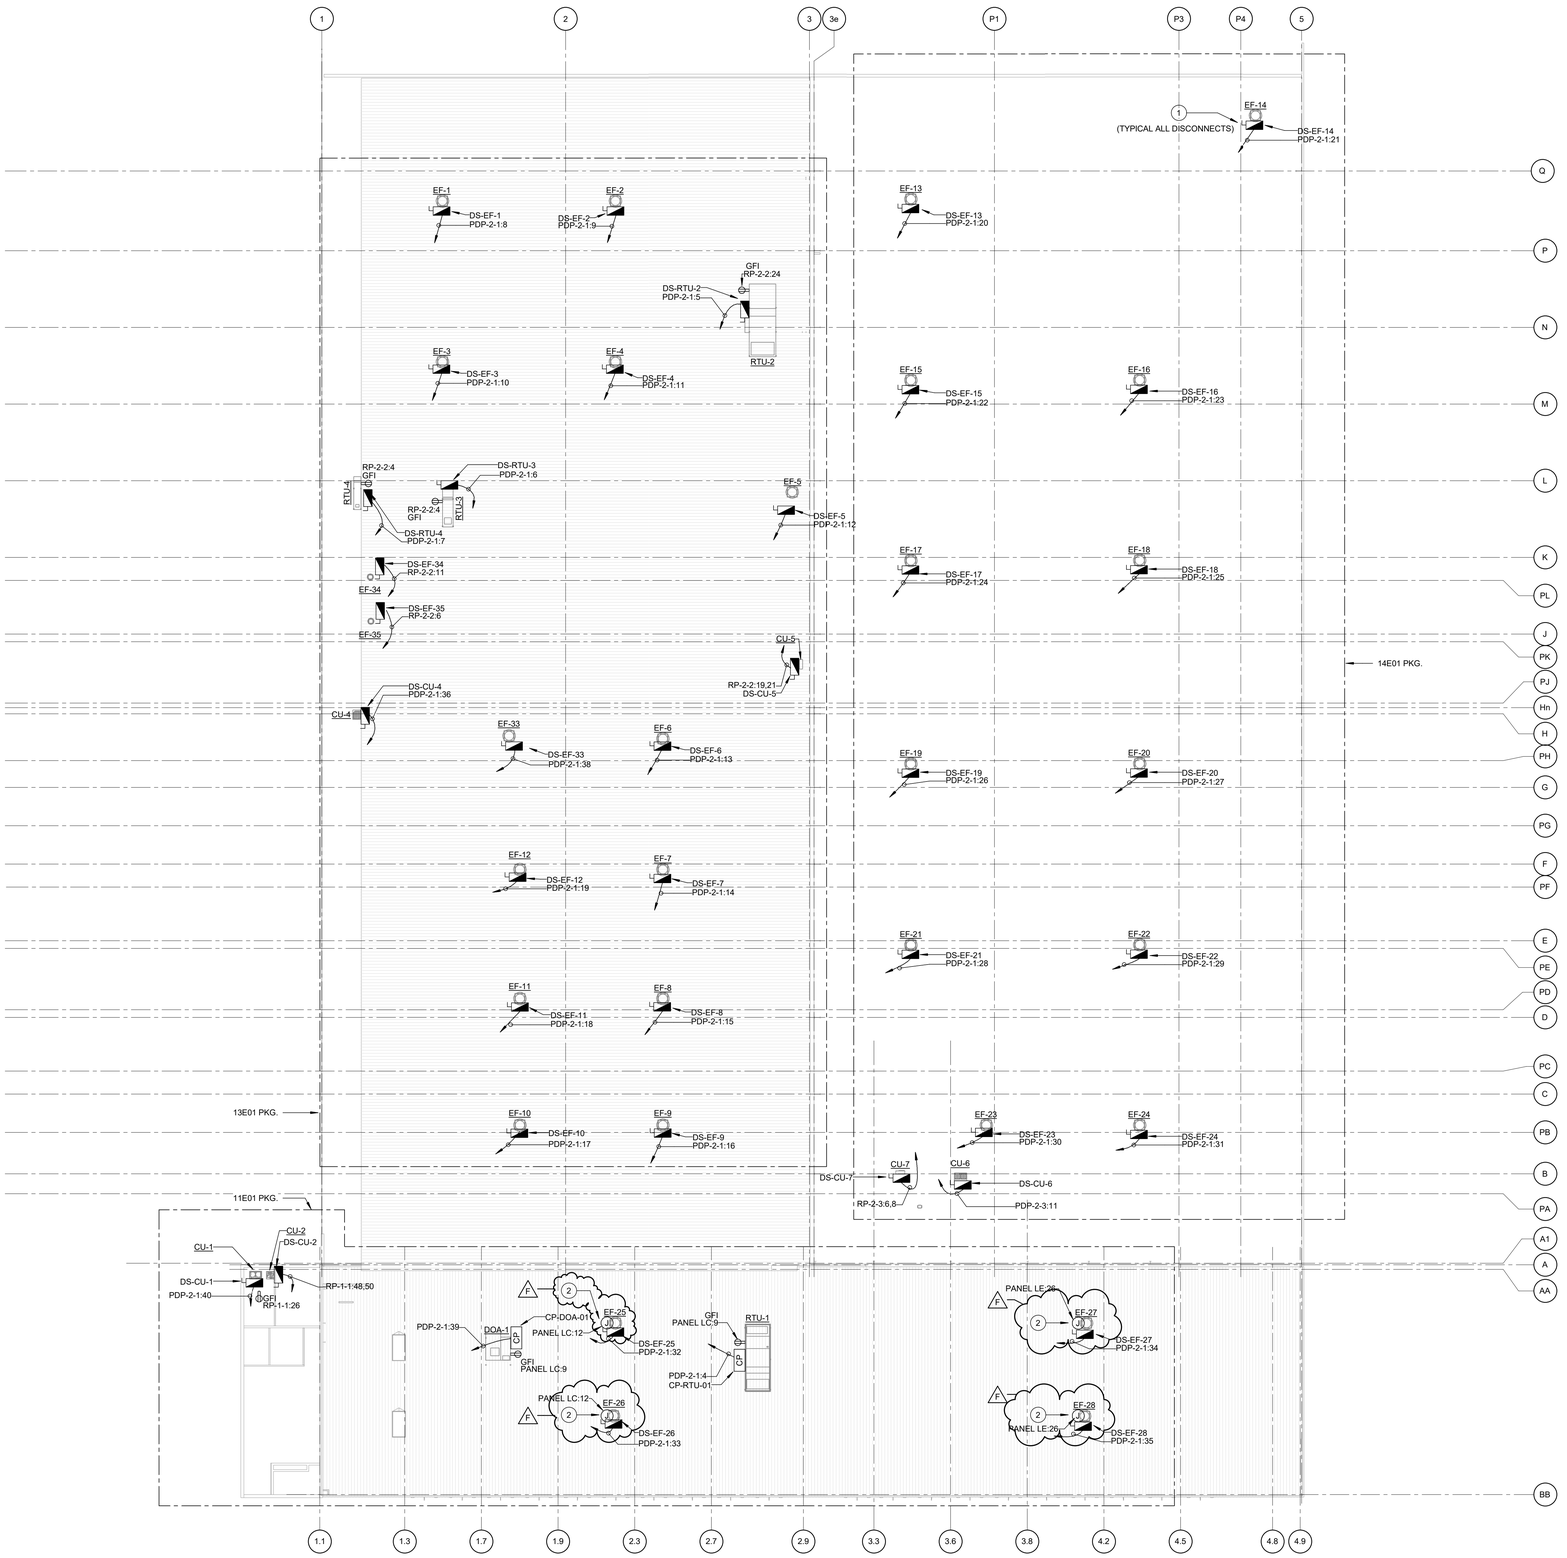

OVERALL ROOF POWER PLAN

SCALE: 1" = 20'-0"

GENERAL NOTES:

A. REFER TO ARCHITECTURAL FLOOR PLAN AND ELEVATIONS FOR EXACT LOCATION OF DEVICES WHERE INDICATED.

B. ALL RECEPTACLE OUTLETS SHALL BE RATED 20A.

C. ALL DISCONNECT SWITCHES SHALL BE HEAVY DUTY TYPE.

D. PROVIDE GFCI PROTECTION WHERE REQUIRED BY THE NEC WHETHER INDICATED OR NOT.

E. ALL BRANCH CIRCUIT JUNCTION BOXES SHALL BE LABELED WITH THE CIRCUITS ENCLOSED.

F. REFER TO DRAWING EA-003 FOR CIRCUIT REQUIREMENTS.

G. ALL CONDUITS SHALL BE ROUTED CONCEALED UNLESS NOTED OTHERWISE.

H. ALL ELECTRICAL EQUIPMENT MOUNTED ON THE FLOOR SHALL BE MOUNTED ON A 4" CONCRETE HOUSEKEEPING PAD.

J. REFER TO DRAWING EA-002 FOR ADDITIONAL GENERAL NOTES.

K. REFER TO DRAWING SERIES EP-600 FOR ONE-LINE DIAGRAMS AND PANEL SCHEDULES FOR CONDUCTOR SIZES UNLESS OTHERWISE NOTED.

NOTES:

1. SIZE FUSING AT DISCONNECT PER END-USE EQUIPMENT NAMEPLATE REQUIREMENTS.
2. JUNCTION BOX FOR MOTORIZED DAMPER INSIDE OF BUILDING AT THE EXHAUST FAN. COORDINATE JUNCTION BOX MOUNTING LOCATION WITH MECHANICAL CONTRACTOR.

(F) (2)

SSOE®

CONSULTANTS:

Issued For BULLETIN
10/10/2022
www.ssoe.com

SEAL ON THIS DOCUMENT AUTHORIZED BY:

APPLY STAMP IN BLUEBEAM

PROJECT INFORMATION:

BROWNFIELD MODIFICATIONS

CLIENT INFORMATION:

ASCEND ELEMENTS
ASCEND ELEMENTS
9172 INDUSTRIAL DR NE
COVINGTON, GA
30014

CLIENT PROJECT NO: XXX-XXXXX-XX

NO.	DATE	SUBJECT
F	10/10/22	BULLETIN 3 - PKG 11E01
E	09/27/22	FOR CONSTRUCTION - PKG 14E01
D	07/14/22	FOR CONSTRUCTION - PKG 13E01
C	05/03/22	FOR CONSTRUCTION - PKG 11E01
B	04/28/22	FOR PERMIT - PKG 11E01
A	03/15/22	ISSUED FOR CONSTRUCTION

REVISION OR ISSUE

SSOE, Inc.
1001 Madison Avenue
Toledo, OH 43604
T. (419) 255-3830

PROJECT NO: 021-01975-00
PROJECT MANAGER: R. FOX
DESIGNED: D. WOODS
CHECKED: F. ROWE

DRAWING TITLE:
ROOF POWER PLAN - COMPOSITE

DRAWING NO:
EP-150

TB_REV 1.0

BIM 360://Battery Resources Brownfield Modifications/021019750O_E20_SSOE.rvt
DATE: 10/10/2022 8:03:54 AM